


PNEUMATIC VALVE CONNECTIONS

TRANE® CENTRIFUGAL CHILLERS

CNW Return

CNW Supply

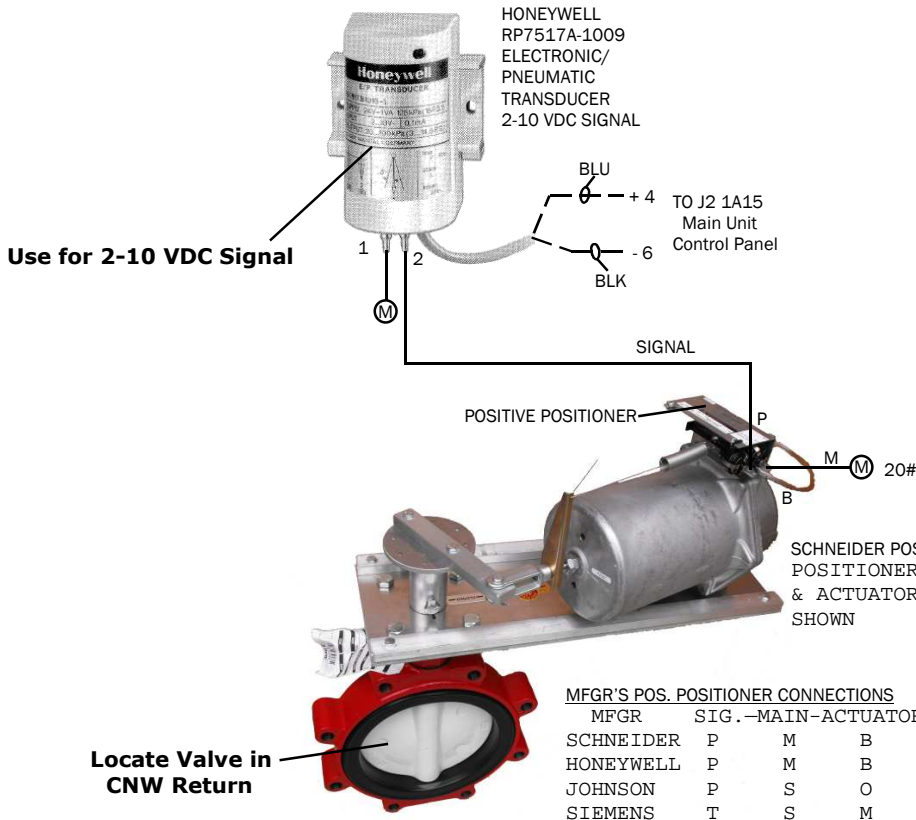

PNEUMATIC CONDENSOR WATER VALVE

For 1/3 2/3 Valve Setup (2 Valves) Use 2 Valve Assemblies with Positive Positioners. Set the 1/3 Valve Assembly Positive Positioner for 4 to 8 PSI and the 2/3 Valve Assembly Positive Positioner for 8 to 12 PSI.



WESLEY VALVE CO.

MFGRS OF AUTOMATED BUTTERFLY VALVES


4938 S. Atlanta Rd., Ste. 100

Atlanta, GA 30339

PHN: (404) 351-8744 FAX: (404) 351-9340

www.Wesleyvalve.com

PNEUMATIC HEAD PRESSURE VALVE CONNECTIONS

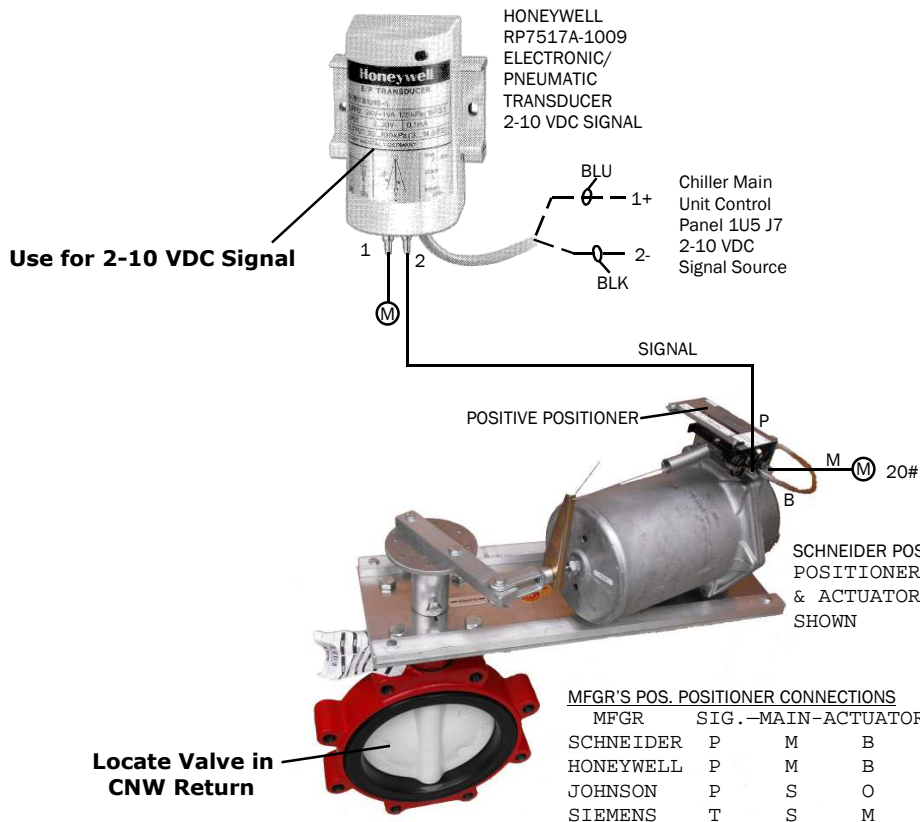

PNEUMATIC CONDENSOR WATER VALVE

For 1/3 2/3 Valve Setup (2 Valves) Use 2 Valve Assemblies with Positive Positioners. Set the 1/3 Valve Assembly Positive Positioner for 4 to 8 PSI and the 2/3 Valve Assembly Positive Positioner for 8 to 12 PSI.



WESLEY VALVE CO.

MFGRS OF AUTOMATED BUTTERFLY VALVES
 4938 S. Atlanta Rd., Ste. 100
 Atlanta, GA 30339
 PHN: (404) 351-8744 FAX: (404) 351-9340
www.Wesleyvalve.com